


**Predicted PV Performance in Austin for April 2009, Daily kWh per kW Installed
Based on 5-minute Averaged Global Horizontal and Diffuse Horizontal Measurements
Texas Solar Energy Laboratory, U.T. Austin**

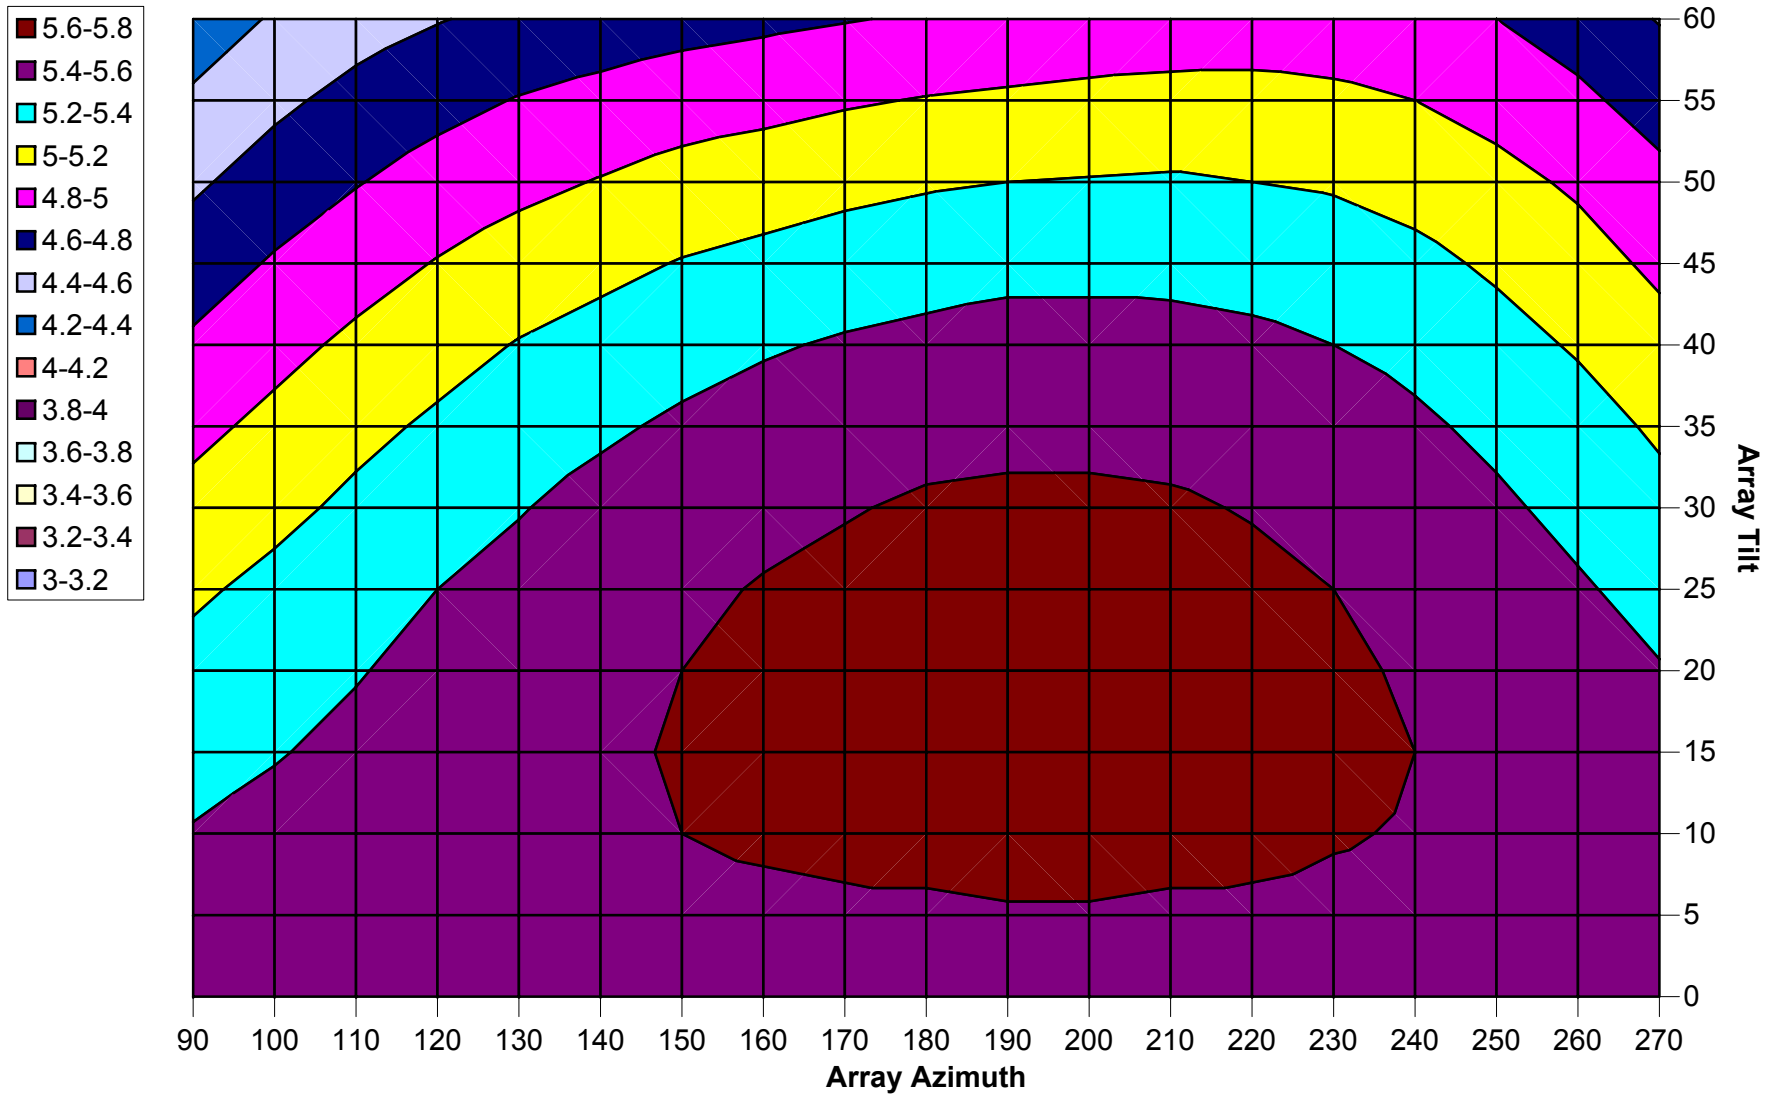

Funding Provided by Austin Energy, Instrumentation Provided by NREL

Key Assumptions:

- Efficiency = 14%
- Panel surface area = 1 square meter per 140 W rated power

Prof. Mack Grady

Dept. of Electrical & Computer Engr.

U.T. Austin

www.ece.utexas.edu/~grady